

TENT, CANOPY & TEMPORARY MEMBRANE STRUCTURES PLAN REVIEW AND PERMIT REQUIREMENTS



Town of Brighton
Office of the Fire Marshal
OCTOBER 2018

Tent, Canopy and Temporary Membrane Structures Guidelines

Purpose

The intent of this guideline is to provide the minimum standards needed to obtain a permit to erect temporary Membrane structures, tents or canopies.

Scope

This guideline shall apply to tents and temporary membrane structures having an area in excess 400 square feet and canopies in excess of 400 square feet. The requirements are from 2015 Fire Code New York State (FCNYS) Chapter 31.

FCNYS 3103.2 Approval required. Tents and membrane structures having an area in excess of 400 square feet (37 m²) shall not be erected, operated or maintained for any purpose without first obtaining a permit and approval from the *fire code official*.

An installation permit is **NOT** required for **tents open on all sides** that comply with **all of the following**:

1. Individual tents having a maximum size of 700 square feet (65 m²).
2. The aggregate area of multiple tents placed side by side without a fire break clearance of 12 feet (3658 mm), not exceeding 700 square feet (65 m²) total.
3. A minimum clearance of 12 feet (3658 mm) to all structures and other tents.

Temporary tents, air-supported, air-inflated or tensioned membrane structures and canopies shall not be erected for a period of more than 180 days within a 12-month period on a single premise.

Zoning

FIRST, you will need to talk to a Town of Brighton Building & Planning Department representative to determine if the tent/canopy or air-supported structure can be erected at the proposed location. If the Town of Brighton Zoning Ordinance does not allow the temporary structure(s) to be erected at a given location, you will need to talk with a Building & Planning Department representative about the possibility of obtaining a Temporary and Revocable Use Permit.

No Operational Fire Code Permit will be issued without proof of the Temporary and Revocable Use Permit or approval from the Town of Brighton Building and Planning Department.

Definitions

Awning - An architectural projection that provides weather protection, identity or decoration and is wholly supported by the building to which it is attached. This document does not address the installation or use of any awnings. Awnings are regulated by the Building Code of New York State.

Tent - A tent is a temporary structure, enclosure or shelter constructed of fabric or pliable material supported by any manner except by air or the contents it protects.

Canopy - A canopy is a temporary structure, enclosure or shelter constructed of fabric or pliable materials supported by any manner, except by air or the contents it protects, and is open without side walls or drops on 75 percent or more of the perimeter.

Membrane Structure - A membrane structure is an air-inflated, air-supported, cable, or frame-covered structure as defined by the Building Code of New York State, which is erected for fewer than 180 days and

not otherwise defined as a tent, canopy or awning.

Temporary Use - A period of not more than 180 days within a 12-month period on a single premise

Plan Submittal Guidelines

In order for a permit to be issued, construction plans must be submitted to the Office of the Fire Marshal and subsequently reviewed and approved. The applicant must submit for approval a detailed drawing of the structure, its layout, location, separations from other structures, purpose (e.g., retail use, public assembly), and the permit application.

The following information is required to obtain a permit for a tent, canopy or temporary membrane structure:

1. A statement which identifies the intended use of all structures and the dates for which the permit is required. Dates shall include the specific dates of installation, use and removal.
2. Flame retardant certificate(s) for tent/canopy material per FCNYS § 3104.2 must be accompanied with documentation certifying treatment of tents, canopies, membrane structures and their appurtenances; sidewalls, drops and tarpaulins; floor coverings, bunting and combustible decorative materials and effects, including sawdust when used on floors or passageways, shall meet the flame propagation performance of NFPA 701 or shall be treated with an approved flame retardant, per FCNYS §3104.2.


(See Exhibit A)



The image shows a 'Certificate of Flame Resistance' form. At the top left is the State of California seal. The title 'Certificate of Flame Resistance' is centered. Below the title, there are fields for 'REGISTERED FABRIC OR CONCERN NUMBER' and 'Date named or manufactured'. A statement reads: 'This is to certify that the materials described on the reverse side hereof have been flame-retardant treated (or are inherently nonflammable)'. Below this are fields for 'FOR', 'ADDRESS', 'CITY', and 'STATE'. A section titled 'Certification is hereby made that: (Check "a" or "b")' contains two options: (a) 'The articles described on the reverse side of this Certificate have been treated with a flame-retardant chemical approved and registered by the State Fire Marshal and that the application of said chemical was done in conformance with the laws of the State of California and the Rules and Regulations of the State Fire Marshal.' and (b) 'The articles described on the reverse side hereof are made from a flame-resistant fabric or material registered and approved by the State Fire Marshal for such use.' Below these are fields for 'Name of chemical used', 'Chem. Reg. No.', 'Method of application', and 'Trade name of flame-resistant fabric or material used'. A line for 'The Flame Retardant Process Used' is followed by 'Be Removed By Washing'. At the bottom, there are fields for 'Name of Applicator or Production Superintendent' and 'By' (Name and Title). The form number 'FB-8' is at the bottom left. A footer box contains the text: 'THIS REPRODUCIBLE NETWORK IS FOR THE EXCLUSIVE USE OF STATE FIRE MARSHAL LICENSED CONCERNS AND INDIVIDUALS FOR THE PRODUCTION OF REQUIRED FORMS.'

3. An accurate scale or dimensioned site diagram shall be provided and attached to the Permit Application indicating distances from tents or temporary membrane structures to permanent buildings, access drives, vehicles and parking areas, other tents or canopies, cooking and heating appliances and equipment, property lines and roadways. (See Exhibit B).
4. An unobstructed fire break passageway or fire road not less than 12' wide and free from guy ropes or other obstructions shall be maintained on all sides of all tents, canopies and membrane structures unless otherwise approved by the Fire Marshal, per FCNYS §3103.8.6.
5. Tent/structure interior layout drawing. The interior drawing shall be drawn to scale and dimensioned. The interior layout drawing shall indicate the locations of the exits, fire extinguishers, no smoking signs, seating arrangement, table arrangement, location and height of platforms/stages, aisle widths and guywire placements in relationship to exit pathways.

EXHIBIT B

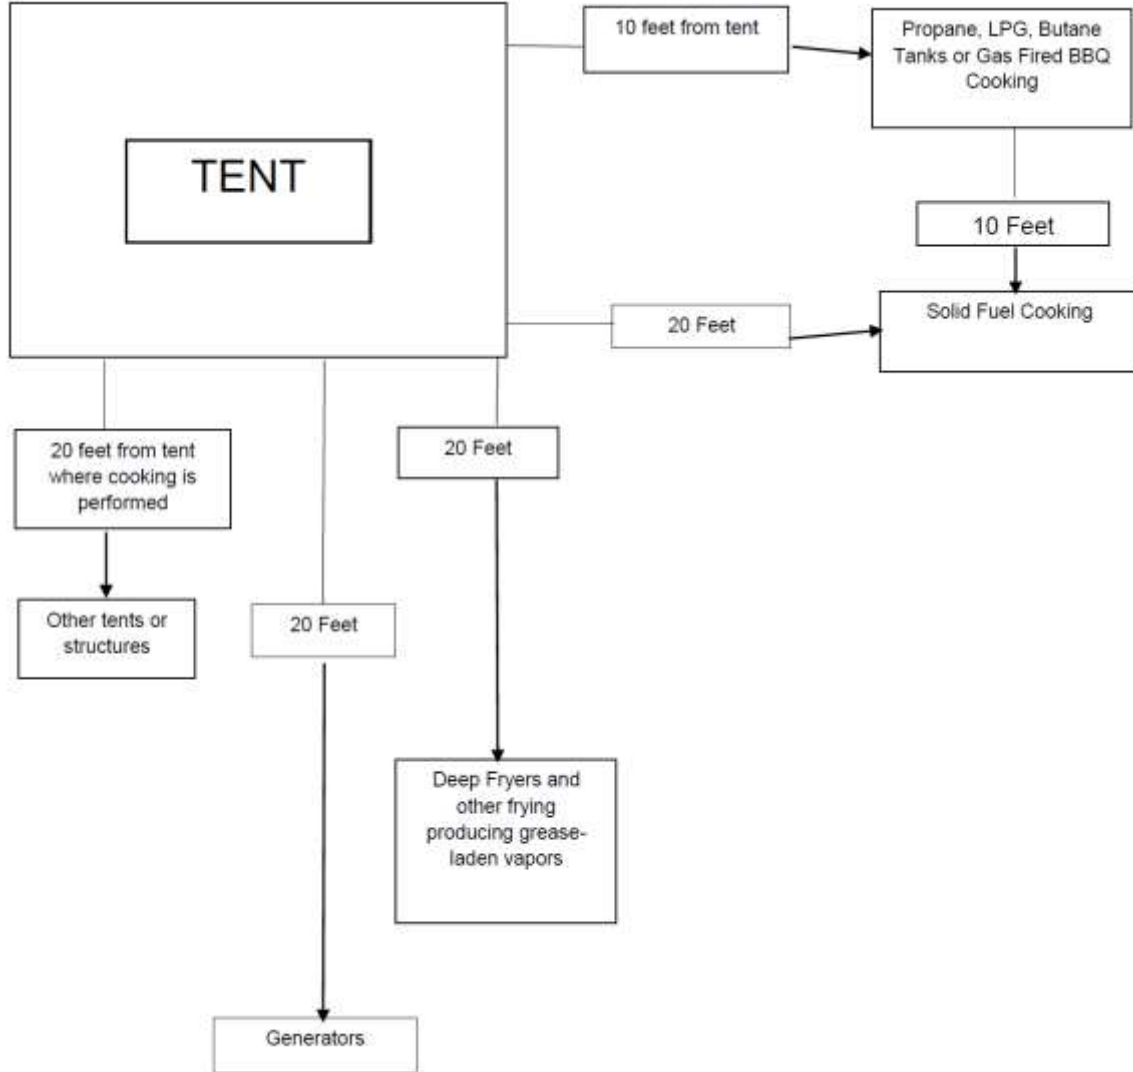

6. Proposed seating arrangements (FCNYS § 3103.11 and Chapter 10)

Locations and dimensions of tables and types of all other interior obstacles

- a. Exit locations; dimensions required for exits as required by FCNYS §3103.12
- b. Locations of all aisles and emergency exit pathways to be maintained per FCNYS §3103.12.5.1
- c. Locations of NO SMOKING signs per FCNYS § 3104.6.
- d. Locations and type of means of egress illumination, including proposed power source(s) per FCNYS §3103.12.6.
- e. Locations and types of EXIT signs, including the means of illumination per FCNYS §3103.12.6.
- f. Location of portable fire extinguishers. (FCNYS §3104.12 and FCNYS §906)
- g. Location and width of all-weather fire access roadways. (FCNYS §3103.8.1)
- h. Locations of any additional emergency equipment such as hose lines or water supplies (FCNYS §3104.13.)
- i. Location and type(s) of proposed heating and/or cooking equipment or open flame devices to be used in conjunction with the event: (FCNYS §3104.15.)

j. The proposed maximum occupant load per FCNYS §3104.14 and FCNYS Chapter 10.

- *Maximum occupant load shall be posted when the occupant load exceeds 50 persons.*

Anchorage

Tents, canopies or membrane structures and their appurtenances shall be adequately roped, braced and anchored to withstand the elements of weather and prevent against collapsing. Documentation of structural stability shall be furnished to the code enforcement official on request.

Code Requirements

Exit covers. Openings in the structure shall remain open unless covered by a flame-resistant curtain. Curtains are to be free sliding on a metal support, and when open, shall not obstruct the exit width. Curtains shall be a color that contrasts with the tent.

Aisles. The minimum width of any public aisle is 44 inches. Aisles for employees only, may be 24 inches wide, but not less than the width required by the number of employees served. Aisles in seating areas shall progressively increase in width to provide, at all points, not less than 1 foot of width for each 50 persons served by such aisle at that point.

Exit signs and illumination. An exit sign shall be provided for each exit when the occupant load exceeds 50. Exit signs shall be illuminated by either an approved self-luminous type or shall be internally or externally illuminated by fixtures supplied in an approved manner. Means of egress shall be illuminated in an approved manner, with light having not less than 1 foot-candle at the floor level while the structure is occupied.

Maintenance of exits. The required clear width of all exits, aisles, and passageways to a public way shall be maintained from any obstacles at all times. Support ropes, guy wires and other support members shall not cross a means of egress at a height of less than 8 feet over the entire clear width of the exit.

Table 3103.12.2

EXITS FROM TENTS, CANOPIES AND TEMPORARY MEMBRANE STRUCTURES ¹

Occupant Load	Minimum number of means of egress	Minimum width of each means of egress (inches)	
		Tent	Membrane Structure
10 to 199	2	72	36
200 to 499	3	72	72
500 to 999	4	96	72
1000 to 1999	5	120	96
2000 to 2999	6	120	96
Over 3000	7	120	96

¹ When the occupant load exceeds 3000, the total width of means of egress (in inches) shall not be less than the total occupant load multiplied by 0.2 inches per person.

Fire Extinguishers

Portable Fire Extinguishers. Fire extinguishers and other fire-protection appliances shall be provided in every tent, canopy, and temporary membrane structure as follows. Fire extinguishers may not be removed from adjacent businesses to provide protection for the structure.

A least one 40BC rated fire extinguisher shall be provided for each kitchen, mess hall, power generator, or transformer and at locations where flammable or combustible liquids are used, stored, or dispensed.

Portable fire extinguishers shall be provided. Travel distance to the nearest 2A:10BC extinguisher shall not exceed 75', per FCNYS §906 and 3104.12.

Portable fire extinguishers shall be located in conspicuous locations where they will be readily accessible and immediately available for use. These locations shall be along normal paths of travel, unless the fire code official determines that the hazard posed indicates the need for placement away from normal paths of travel, per FCNYS §906.5

Fire extinguishers provided for the protection of cooking grease fires shall be Class K, per FCNYS §906.4.

Heating and Cooking Equipment

Heating or cooking equipment, tanks, piping, hoses, fittings, valves, tubing, and other related components shall be installed as specified in the Mechanical Code New York State and shall be approved by the Fire Marshal.

Cooking and heating equipment shall not be located within 10 feet of exits or combustible materials per FCNYS §3104.15.3.

Tents where cooking is performed shall be separated from other tents, canopies or membrane structures by a minimum of 20' per FCNYS §3104.15.5.

Outdoor cooking that produces sparks or grease-laden vapors shall not be performed within 20' of a tent, canopy or membrane structure per FCNYS §3104.15.6.

Operations such as warming of foods, cooking demonstrations and similar operations that use solid flammables, butane or other similar devices which do not pose an ignition hazard, shall be approved per FCNYS §3104.15.4.

Electrical heating and cooking equipment shall comply with the National Electrical Code - NFPA 70 per FCNYS §3104.15.7.

Flammable and Combustible Liquids/Gases

Flammable-liquid-fueled shall not be used in temporary membrane structures, tents or canopies per FCNYS §3104.17.1.

Flammable or combustible liquids and LP-gas shall be stored outside in an approved manner not less than 50' from tents, canopies or membrane structures, per FCNYS §3104.17.2.

Refueling shall be performed in an approved location not less than 20 feet from tents, canopies or membrane structures per FCNYS §3104.17.3